


FOR OFFICE USE ONLY

F2H06
FLOOR TO FLOOR FIRE BARRIER
2 HOUR RATED
100% MOVEMENT

NOTE:
 THE FIRE RATING FOR THIS AND SIMILAR
 CONDITIONS IS DETERMINED BY THE
 PERFORMANCE CAPABILITIES OF THE
 SURROUNDING CONSTRUCTION RATHER
 THAN THE METAFLEX FIRE BARRIER.

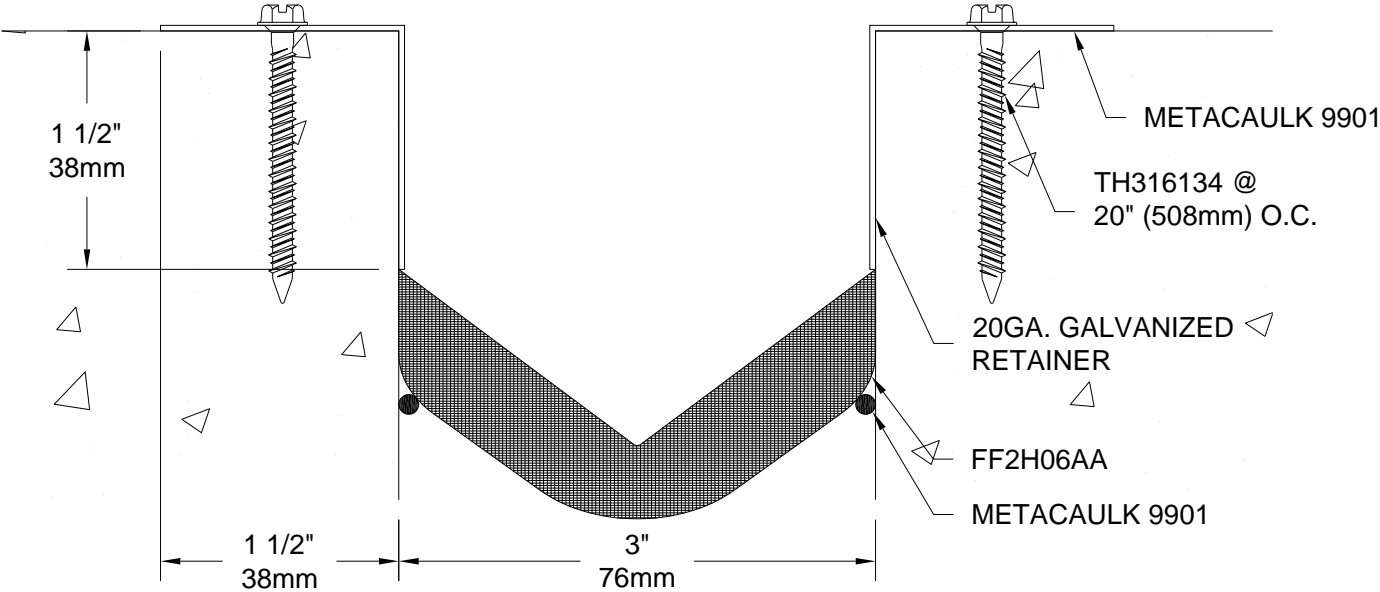

Project

Customer

SO#

Date

1/24/02

Page of

Length	Qty.	Color

Scale: NTS



2626 S. Sheridan PO Box 17249
 Wichita, Kansas 67217-0249 USA
 P: +1-316-945-9328 F: +1-316-945-0789