


F2H08
 FLOOR TO FLOOR FIRE BARRIER
 2 HOUR RATED
 100% MOVEMENT

NOTE:
 THE FIRE RATING FOR THIS AND
 SIMILAR CONDITIONS IS DETERMINED
 NOT ONLY BY THE METAFLEX FIRE
 BARRIER, BUT ALSO THE
 PERFORMANCE CAPABILITIES OF THE
 SURROUNDING CONSTRUCTION

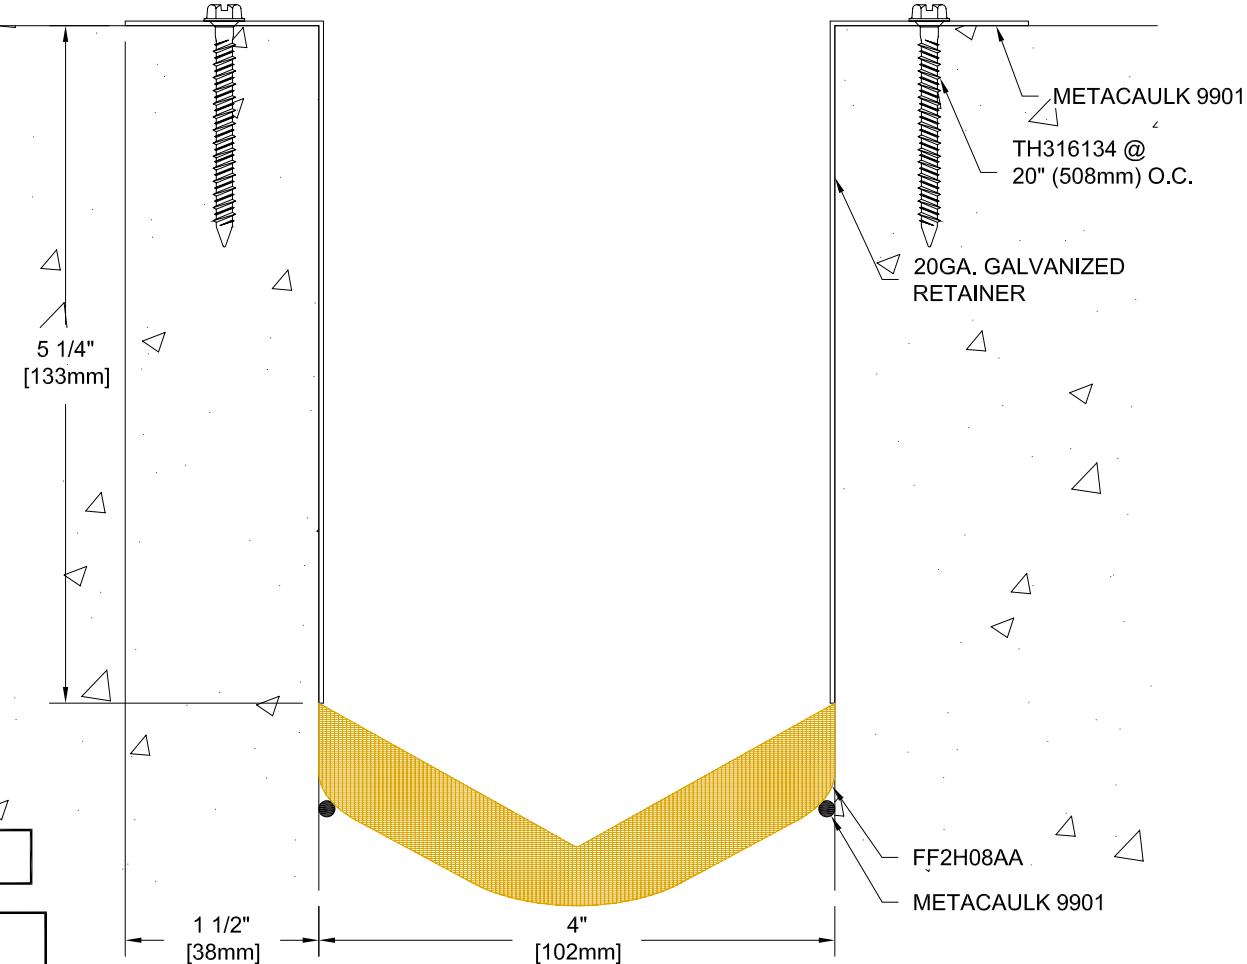

FOR OFFICE USE ONLY

Project

Customer

SO#

Date

Length	Qty.	Color

Page ___ of ___

Scale: NTS

5/24/04



2626 S. Sheridan PO Box 17249
 Wichita, Kansas 67217-0249 USA
 P: +1-316-945-9328 F: +1-316-945-0789