


F2H12

FLOOR TO FLOOR FIRE BARRIER
 2 HOUR RATED
 100% MOVEMENT

NOTE:

THE FIRE RATING FOR THIS AND SIMILAR CONDITIONS IS DETERMINED BY THE PERFORMANCE CAPABILITIES OF THE SURROUNDING CONSTRUCTION RATHER THAN THE METAFLEX FIRE BARRIER.

FOR OFFICE USE ONLY

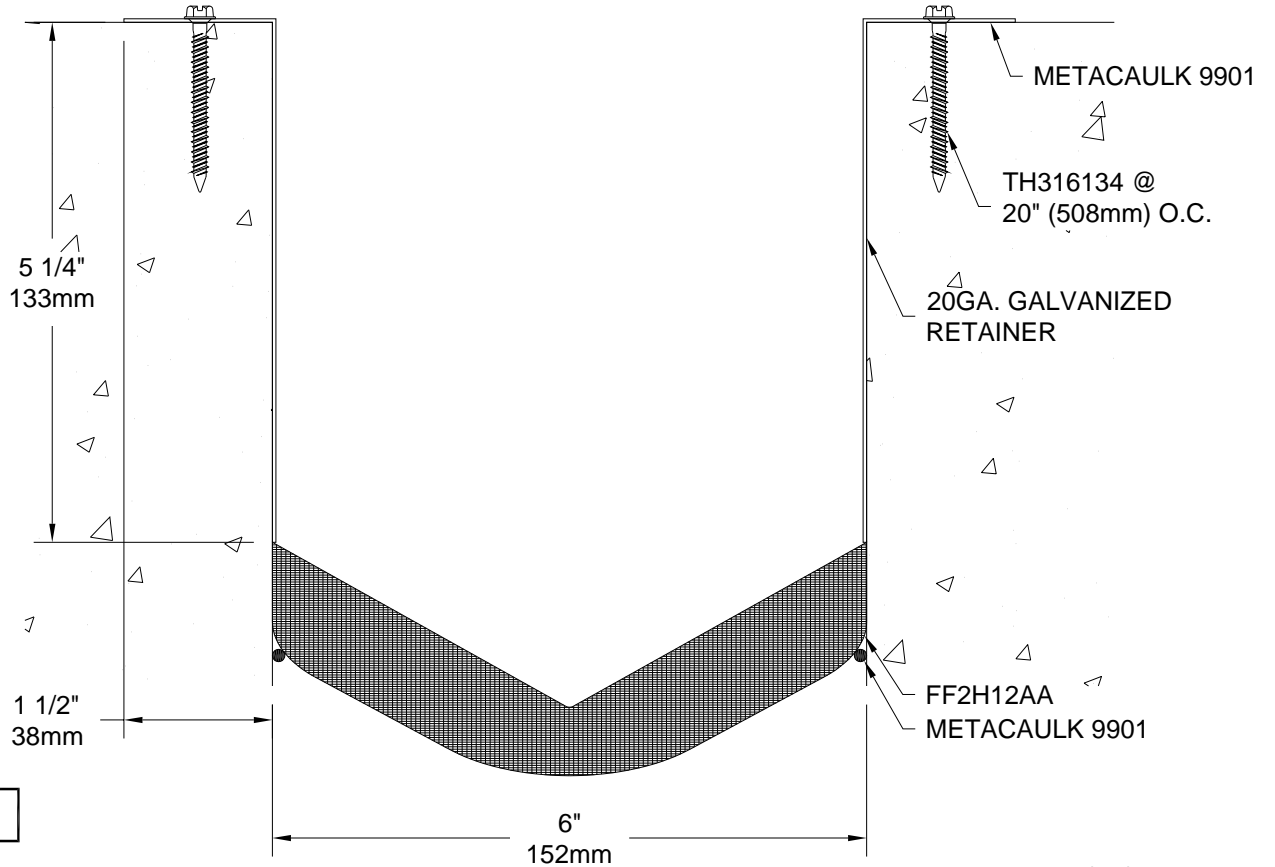

Project

Customer

SO#

Date

1/24/02

Page ___ of ___

Length	Qty.	Color

Scale: NTS



2626 S. Sheridan PO Box 17249
 Wichita, Kansas 67217-0249 USA
 P: +1-316-945-9328 F: +1-316-945-0789