

**MPSFV2H18**


FLOOR FIRE BARRIER

2 HOUR RATED

MAXIMUM OPENING 18" (457mm)

INTERTEK LISTING # BA/EC 120-01

A MINIMUM 3/16" THICK ALUMINUM COVER IS REQUIRED TO MAINTAIN 2 HOUR RATING (BY OTHERS)

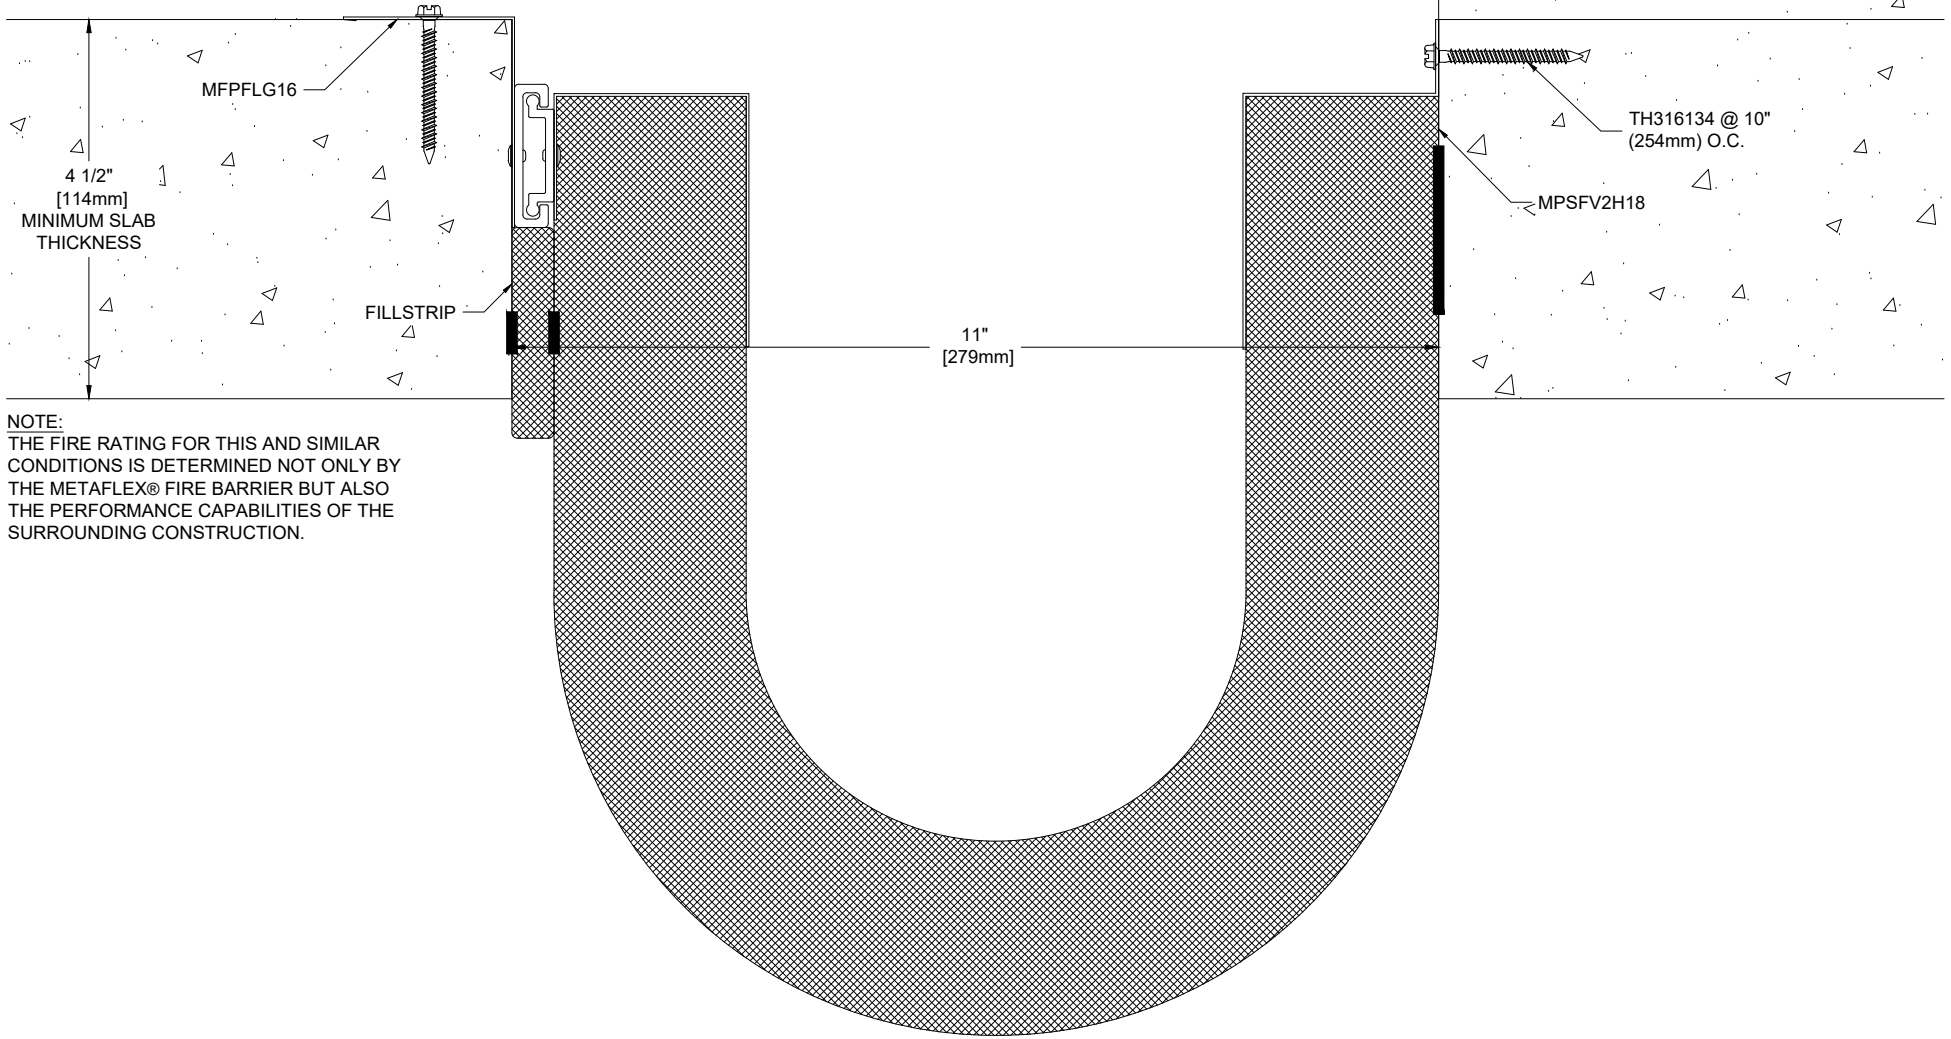

**NOTE:**  
THE FIRE RATING FOR THIS AND SIMILAR CONDITIONS IS DETERMINED NOT ONLY BY THE METAFLEX® FIRE BARRIER BUT ALSO THE PERFORMANCE CAPABILITIES OF THE SURROUNDING CONSTRUCTION.

|                 |            |
|-----------------|------------|
| Project:        |            |
| Customer:       |            |
| SO#             |            |
| Date:           |            |
| Page ___ of ___ | Scale: NTS |

| Length | Qty. | Color |
|--------|------|-------|
|        |      |       |
|        |      |       |
|        |      |       |
|        |      |       |

Drawn By: HRS



A CSW Industrials Company

The information contained herein is the proprietary property of **BALCO**®. No portion of it may be reproduced by any means or used in any form except for the purpose for which it was furnished. All rights of design and invention are hereby reserved.

REV. - 07/10/19