


**MPUF2H08**  
 UNDER-SLAB FLOOR FIRE BARRIER  
 2 HOUR RATED  
 MAXIMUM OPENING 8" (203mm)  
 INTERTEK LISTING # BA/EC 120-02

A MINIMUM 3/16" THICK ALUMINUM  
 COVER IS REQUIRED TO MAINTAIN  
 2 HOUR RATING (BY OTHERS)

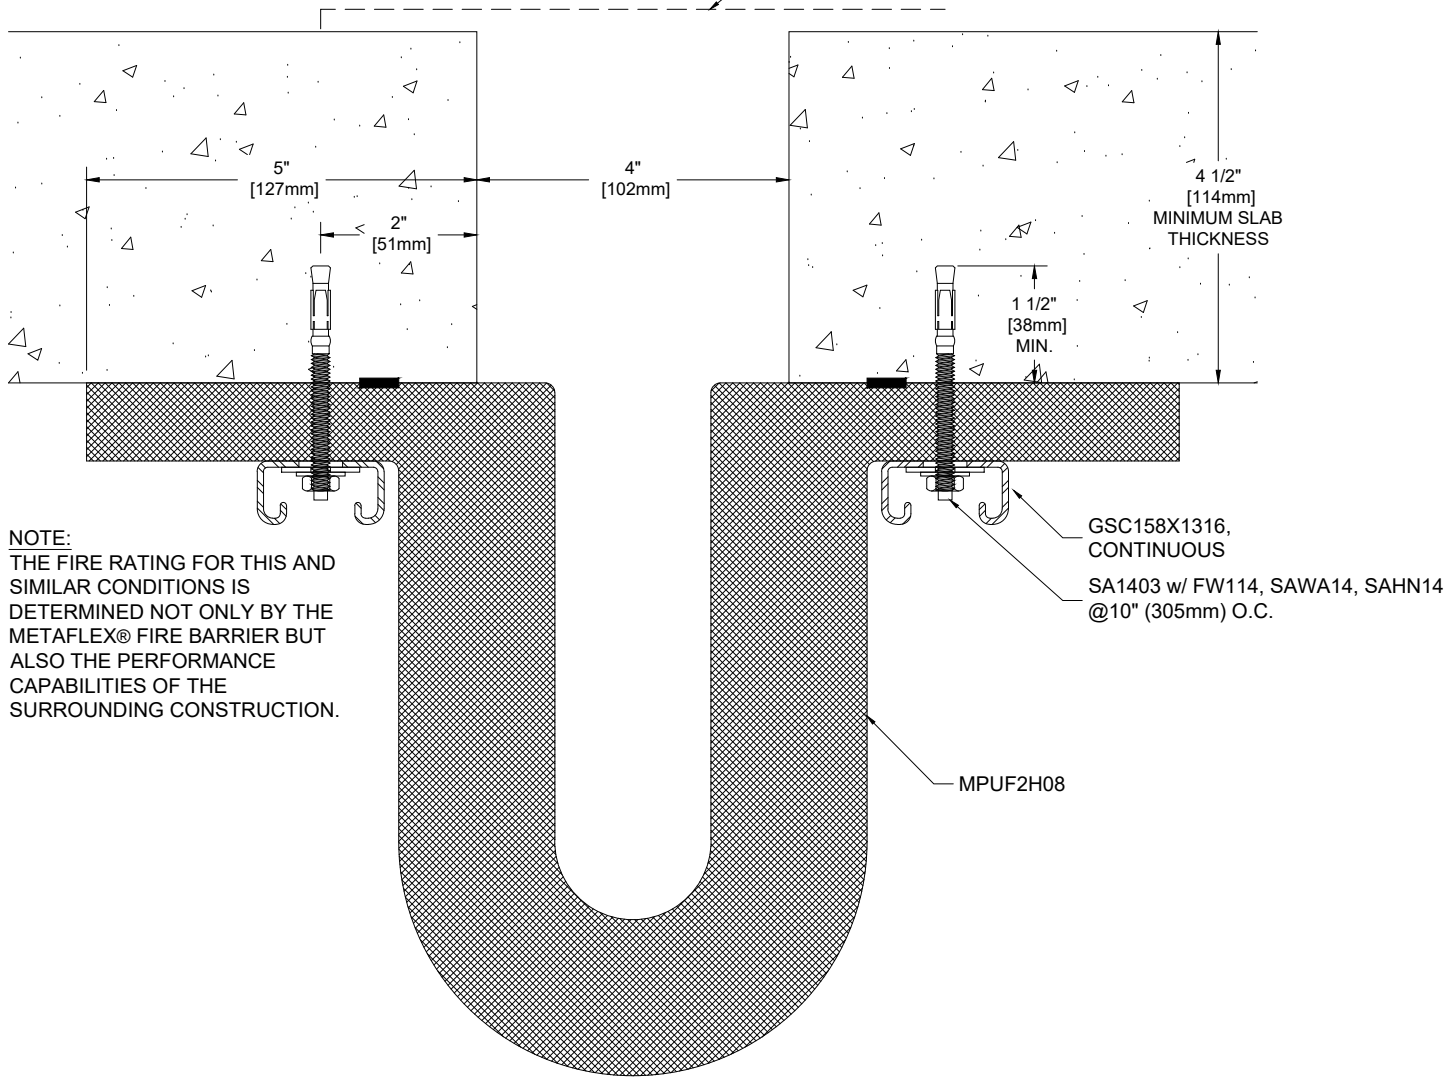

**NOTE:**  
 THE FIRE RATING FOR THIS AND  
 SIMILAR CONDITIONS IS  
 DETERMINED NOT ONLY BY THE  
 METAFLEX® FIRE BARRIER BUT  
 ALSO THE PERFORMANCE  
 CAPABILITIES OF THE  
 SURROUNDING CONSTRUCTION.

GSC158X1316,  
 CONTINUOUS  
 SA1403 w/ FW114, SAWA14, SAHN14  
 @ 10" (305mm) O.C.

MPUF2H08

Project:	
Customer:	
SO#	
Date:	
Page ___ of ___	Scale: NTS

Length	Qty.	Color

Drawn By: HRS



A CSW Industrials Company

The information contained herein is the proprietary property of BALCO®. No portion of it may be reproduced by any means or used in any form except for the purpose for which it was furnished. All rights of design and invention are hereby reserved.

REV. - 07/16/19