


MPUF2H08
 UNDER-SLAB FLOOR FIRE BARRIER
 2 HOUR RATED
 MAXIMUM OPENING 8" (203mm)
 INTERTEK LISTING # BA/EC 120-02

A MINIMUM 3/16" THICK ALUMINUM COVER IS REQUIRED TO MAINTAIN 2 HOUR RATING (BY OTHERS)

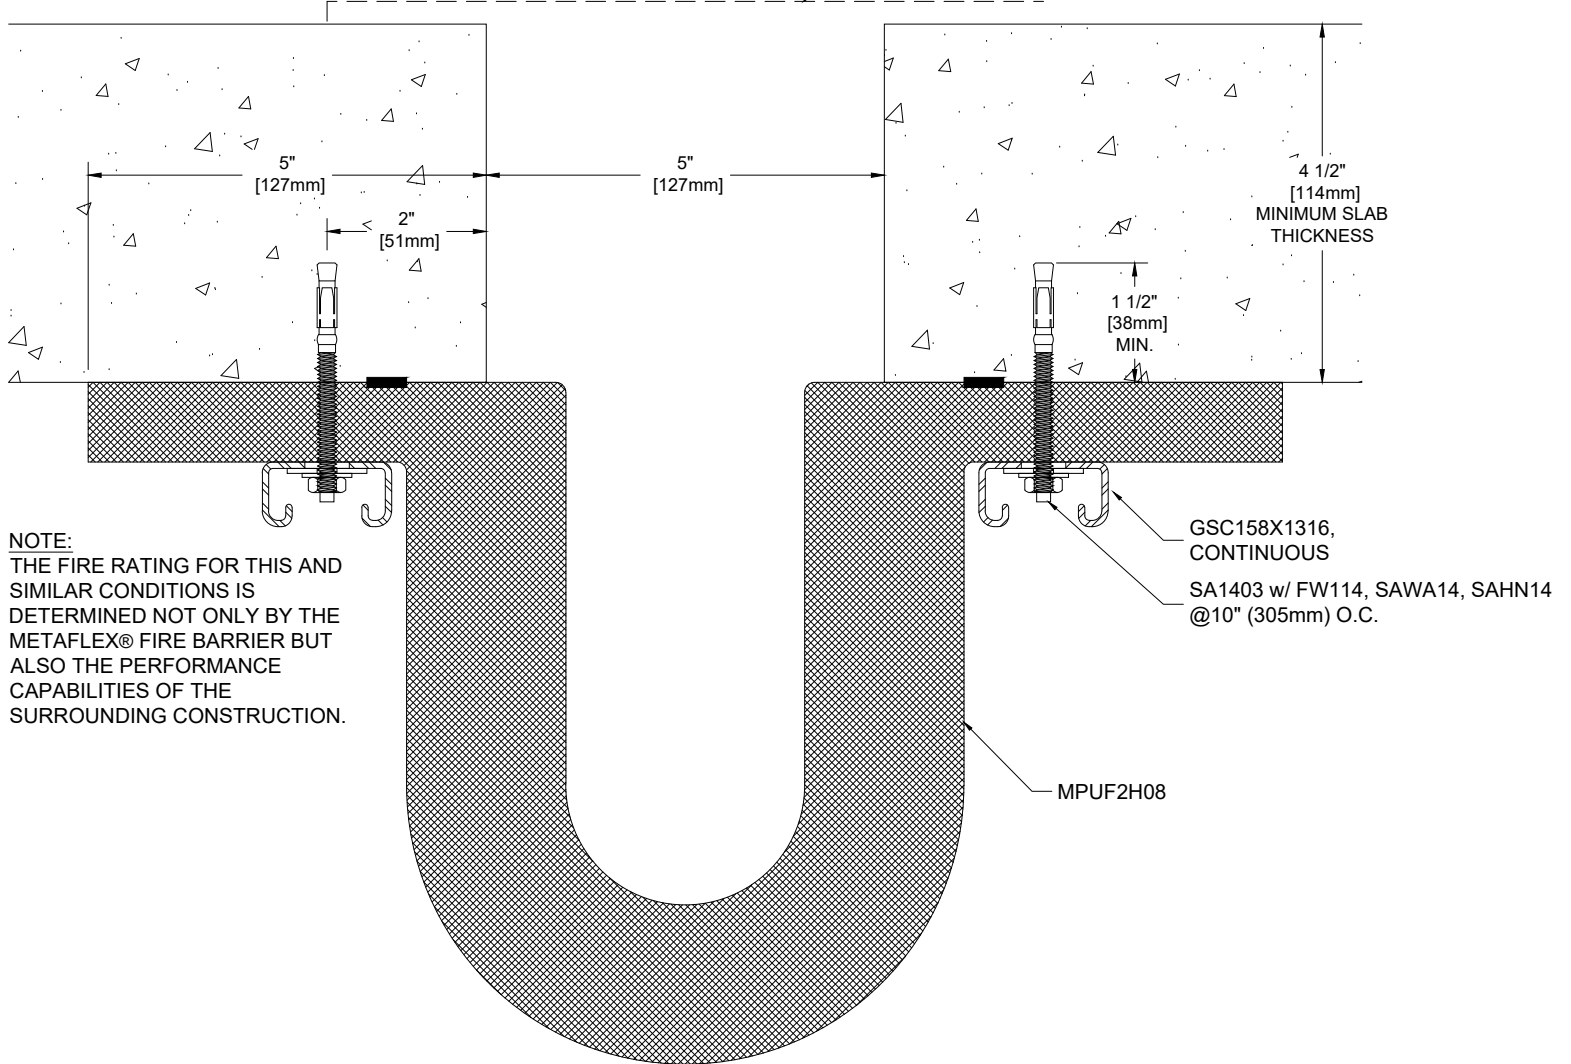

NOTE:
 THE FIRE RATING FOR THIS AND SIMILAR CONDITIONS IS DETERMINED NOT ONLY BY THE METAFLEX® FIRE BARRIER BUT ALSO THE PERFORMANCE CAPABILITIES OF THE SURROUNDING CONSTRUCTION.

GSC-158X1316, CONTINUOUS
 SA1403 w/ FW114, SAWA14, SAHN14 @10" (305mm) O.C.

MPUF2H08

Project:	
Customer:	
SO#	
Date:	
Page ___ of ___	Scale: NTS

Length	Qty.	Color

Drawn By: HRS



A CSW Industrials Company

The information contained herein is the proprietary property of BALCO®. No portion of it may be reproduced by any means or used in any form except for the purpose for which it was furnished. All rights of design and invention are hereby reserved.

REV. - 07/16/19