


MPUF2H18
 UNDER-SLAB FLOOR FIRE BARRIER
 2 HOUR RATED
 MAXIMUM OPENING 18" (457mm)
 INTERTEK LISTING # BA/EC 120-02

A MINIMUM 3/16" THICK ALUMINUM
 COVER IS REQUIRED TO MAINTAIN
 2 HOUR RATING (BY OTHERS)

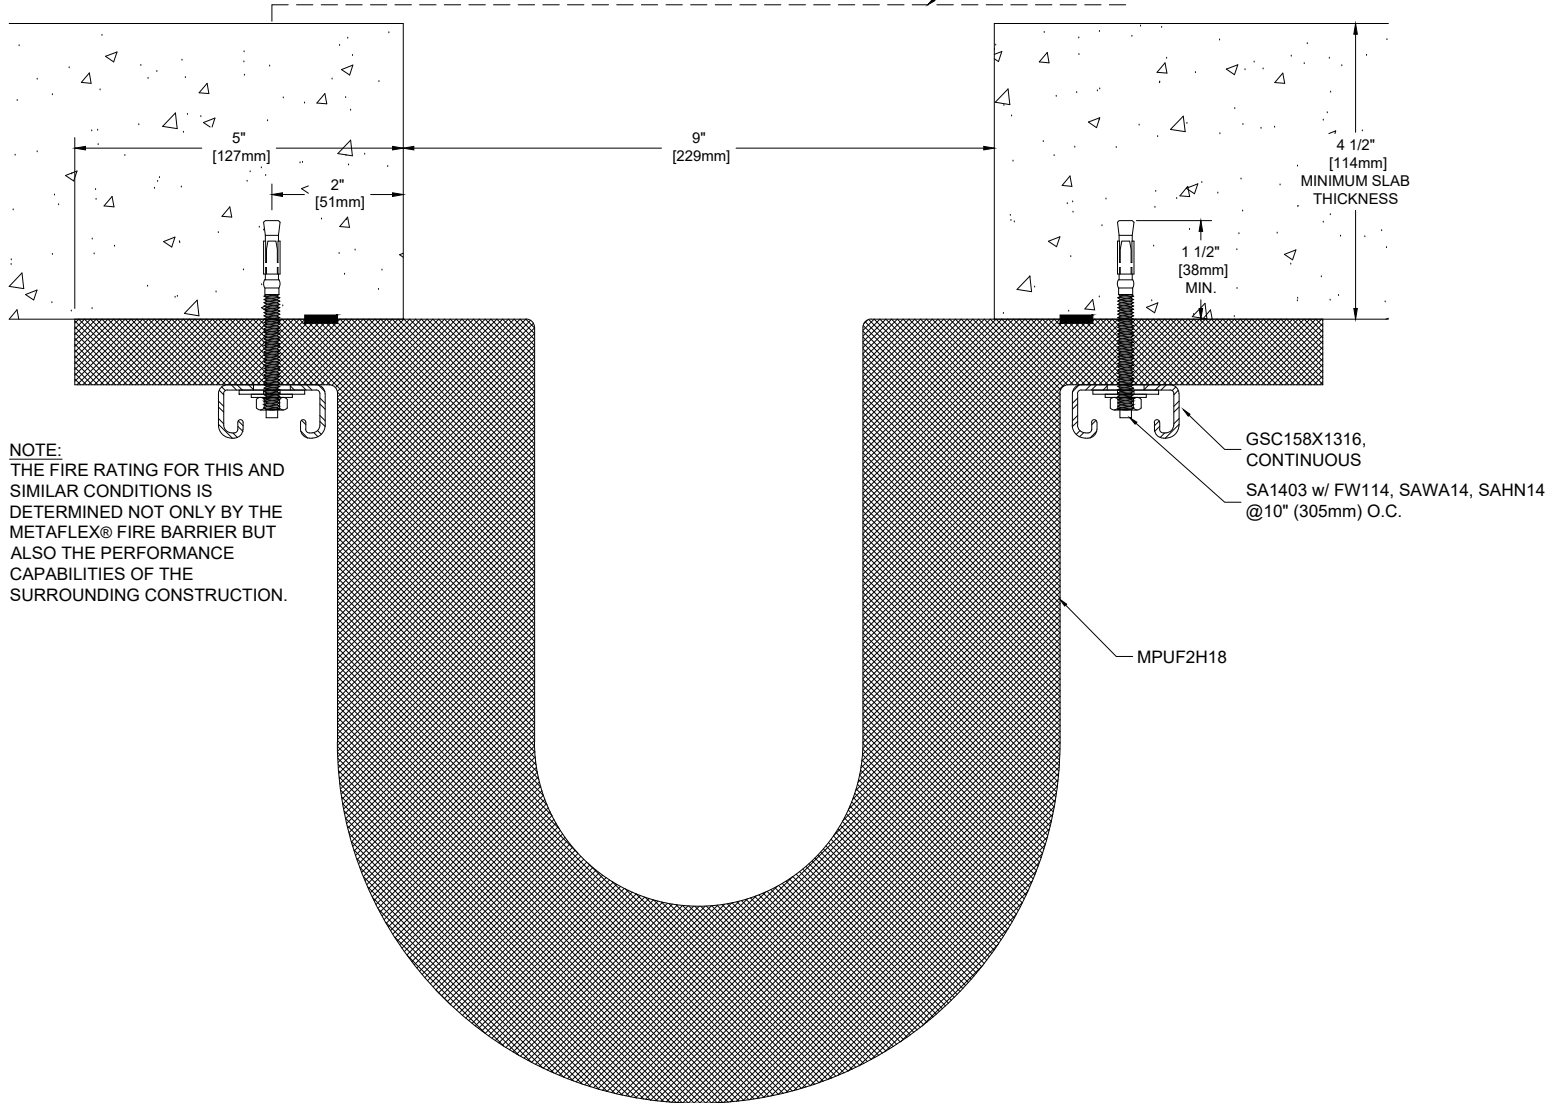

NOTE:
 THE FIRE RATING FOR THIS AND
 SIMILAR CONDITIONS IS
 DETERMINED NOT ONLY BY THE
 METAFLEX® FIRE BARRIER BUT
 ALSO THE PERFORMANCE
 CAPABILITIES OF THE
 SURROUNDING CONSTRUCTION.

GSC158X1316,
 CONTINUOUS
 SA1403 w/ FW114, SAWA14, SAHN14
 @10" (305mm) O.C.

MPUF2H18

Project:	
Customer:	
SO#	
Date:	
Page ___ of ___	Scale: NTS

Length	Qty.	Color

Drawn By: HRS



A CSW Industrials Company

The information contained herein is the proprietary property of **BALCO**®. No portion of it may be reproduced by any means or used in any form except for the purpose for which it was furnished. All rights of design and invention are hereby reserved.

REV. - 07/16/19